






Sample-to-sample distances

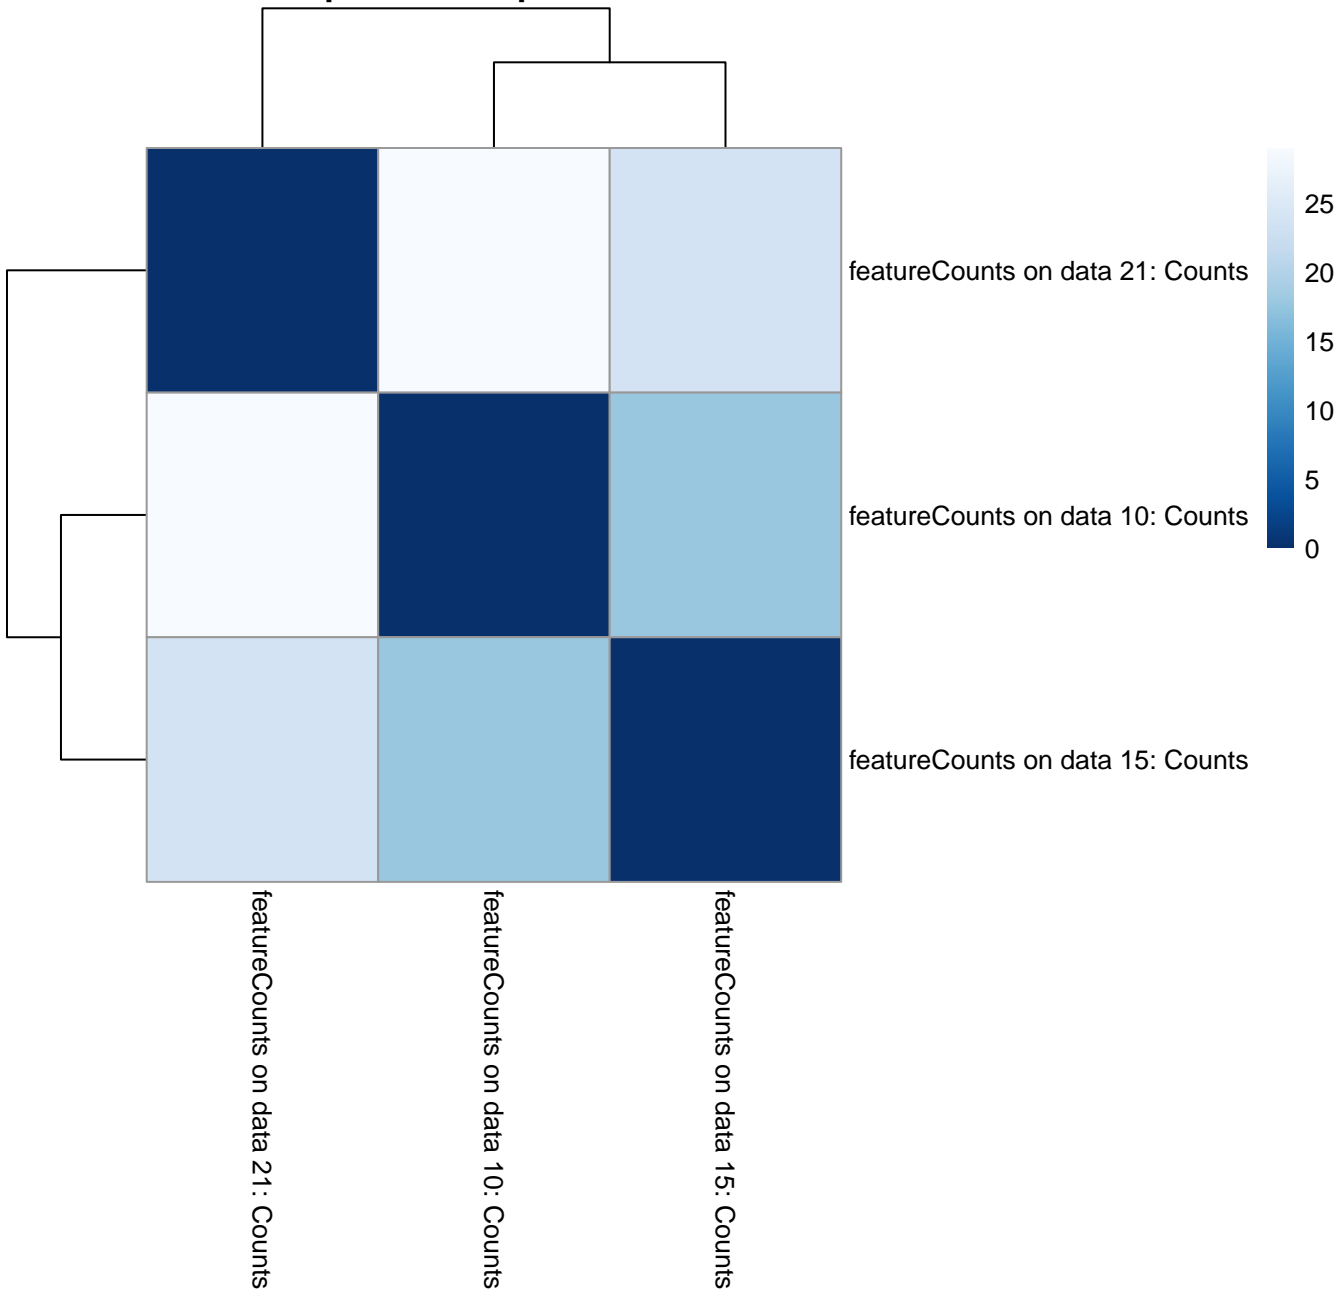


Dispersion estimates

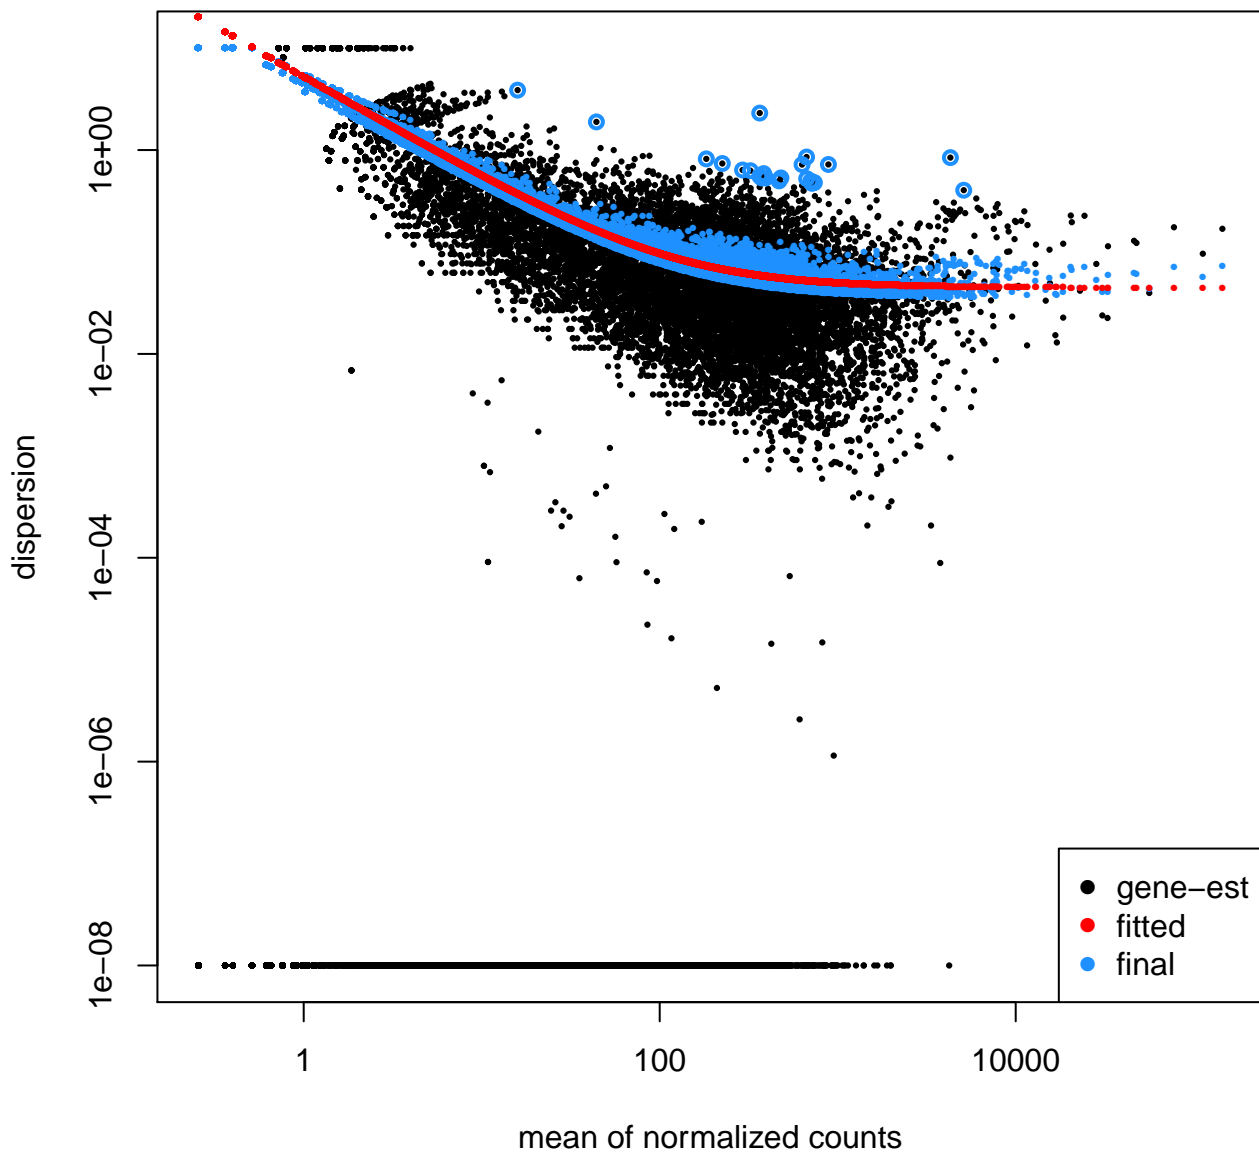


ues for PCBXTreatedXOEXID3XXvsXVectorXControlXLungXEndothelialXCell

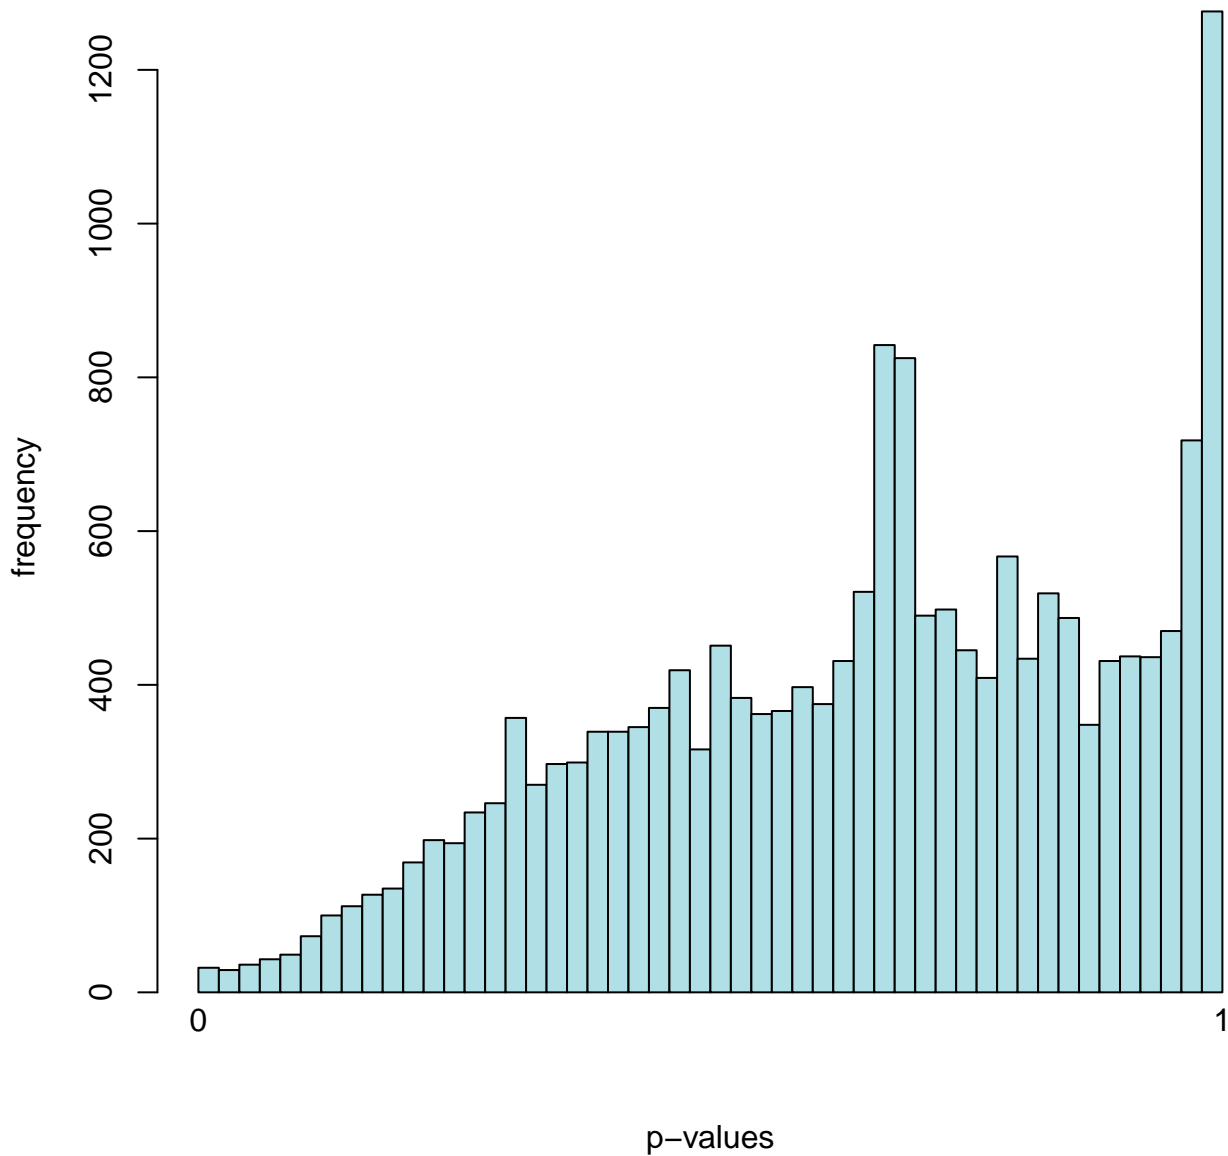


PCBXTreatedXOEXID3XXvsXVectorXControlXLungXEndothelialXCellsX: OE

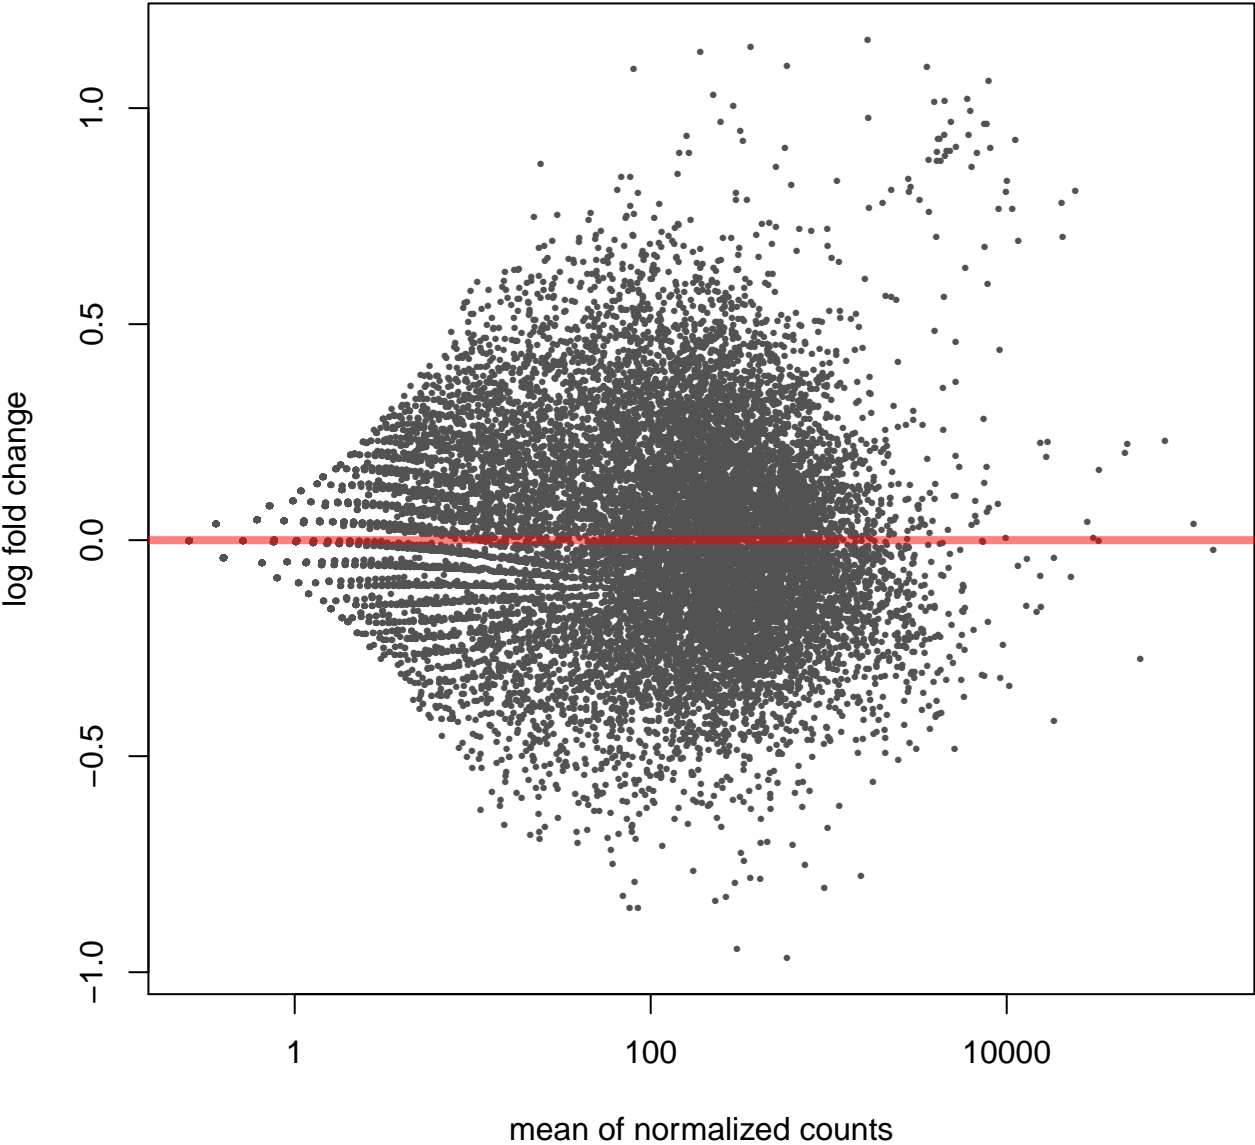


values for PCBXTreatedXOEXID3XXvsXVectorXControlXLungXEndothelialXCe

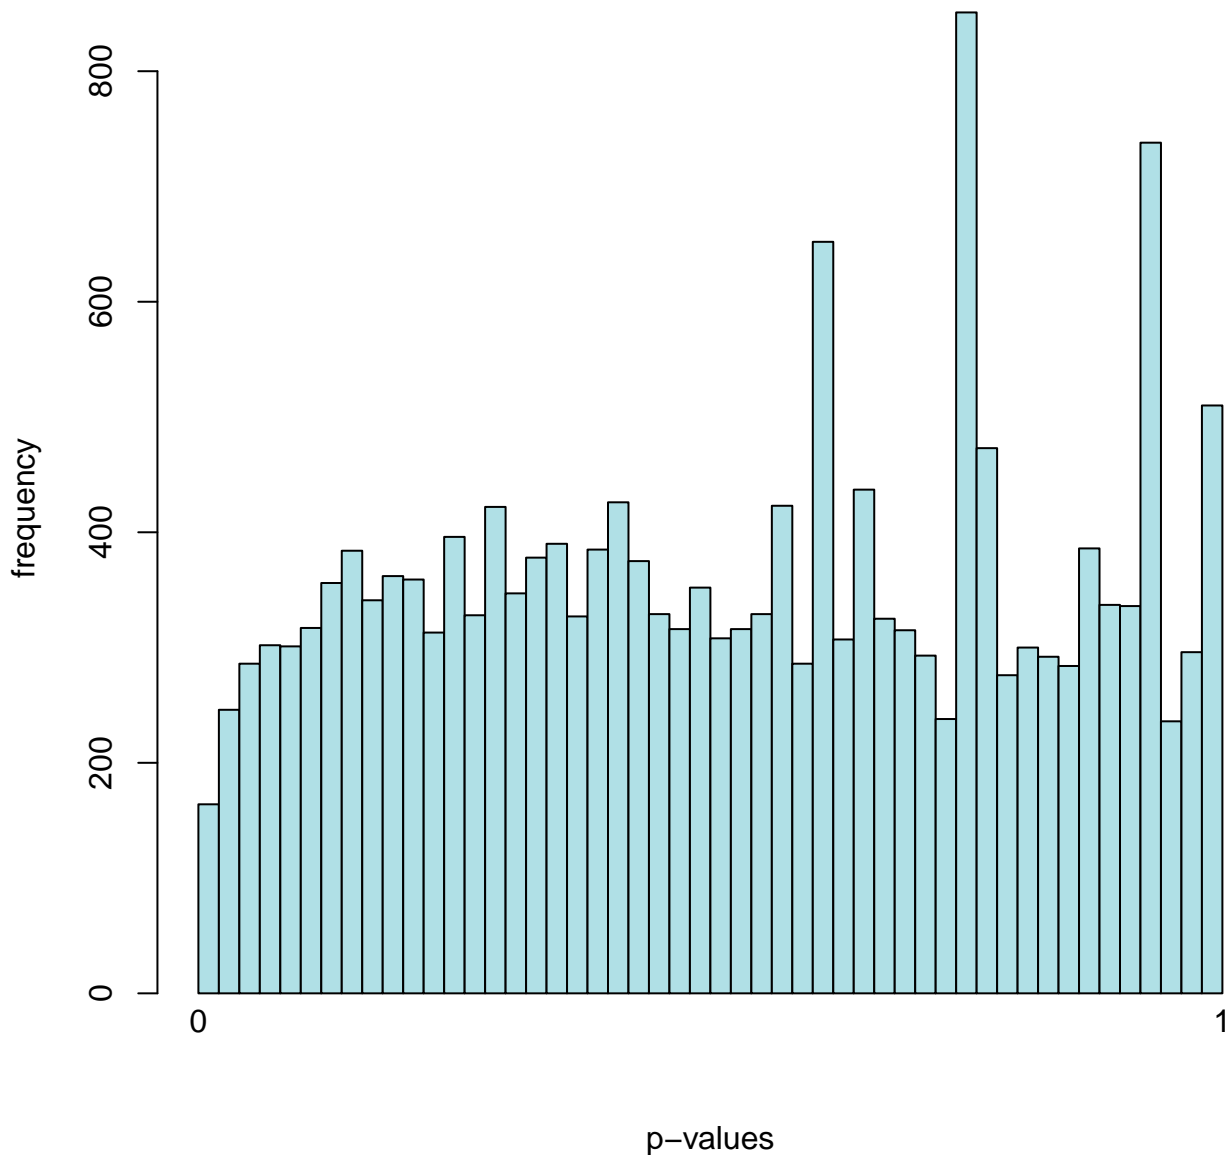

PCBXTreatedXOEID3XXvsXVectorXControlXLungXEndothelialXCellsX: tre

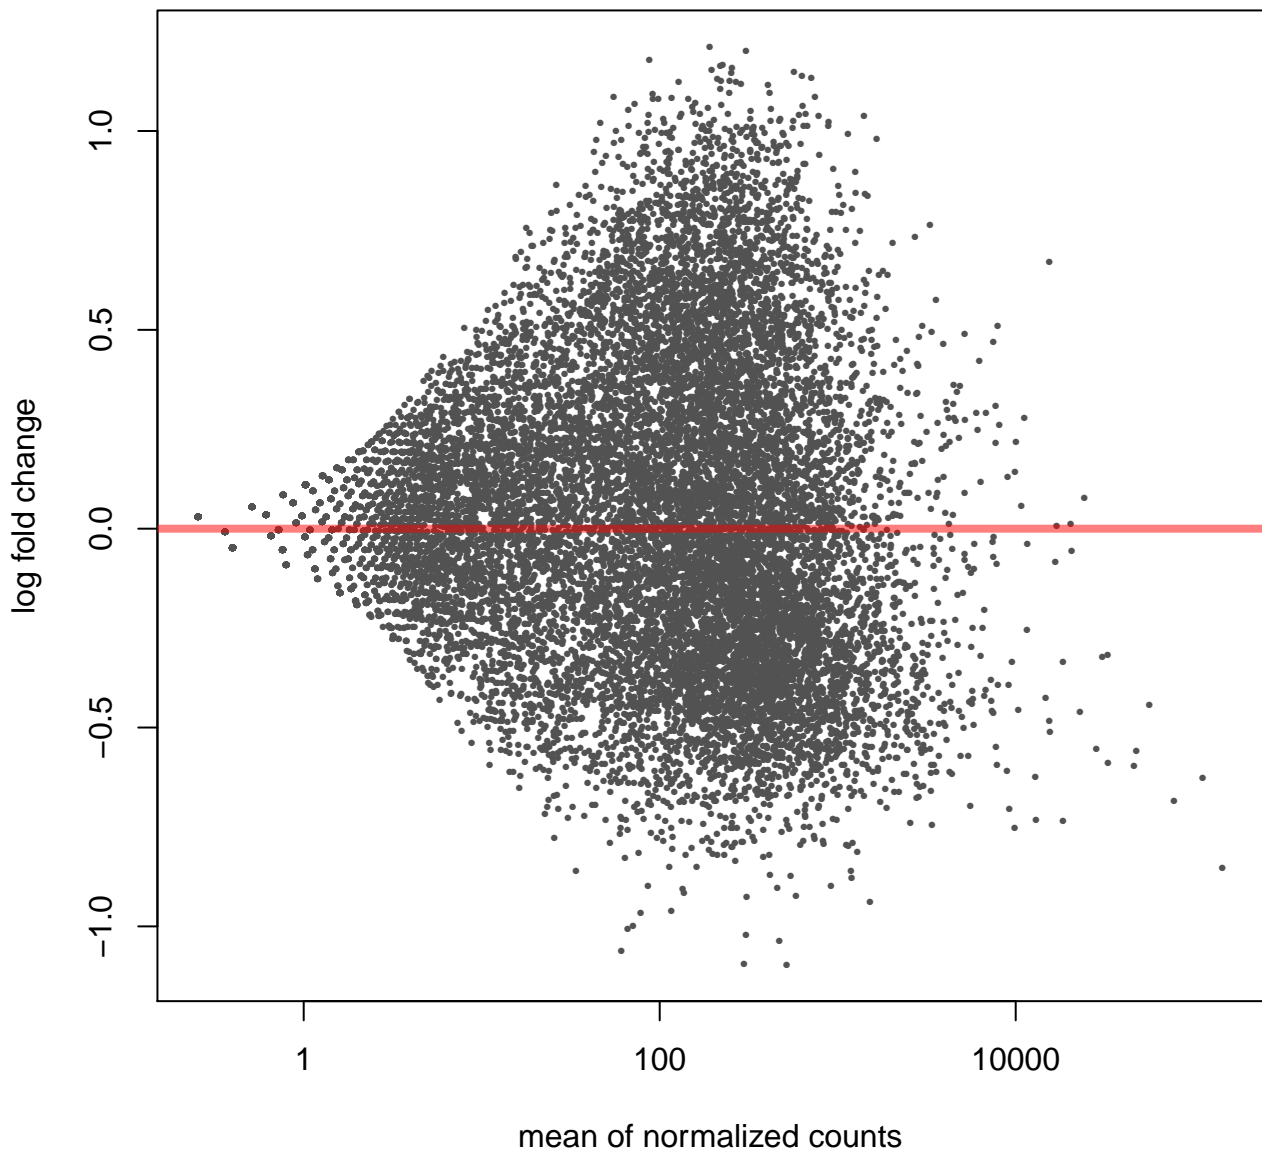

ues for PCBXTreatedXOEXID3XXvsXVectorXControlXLungXEndothelialXCell

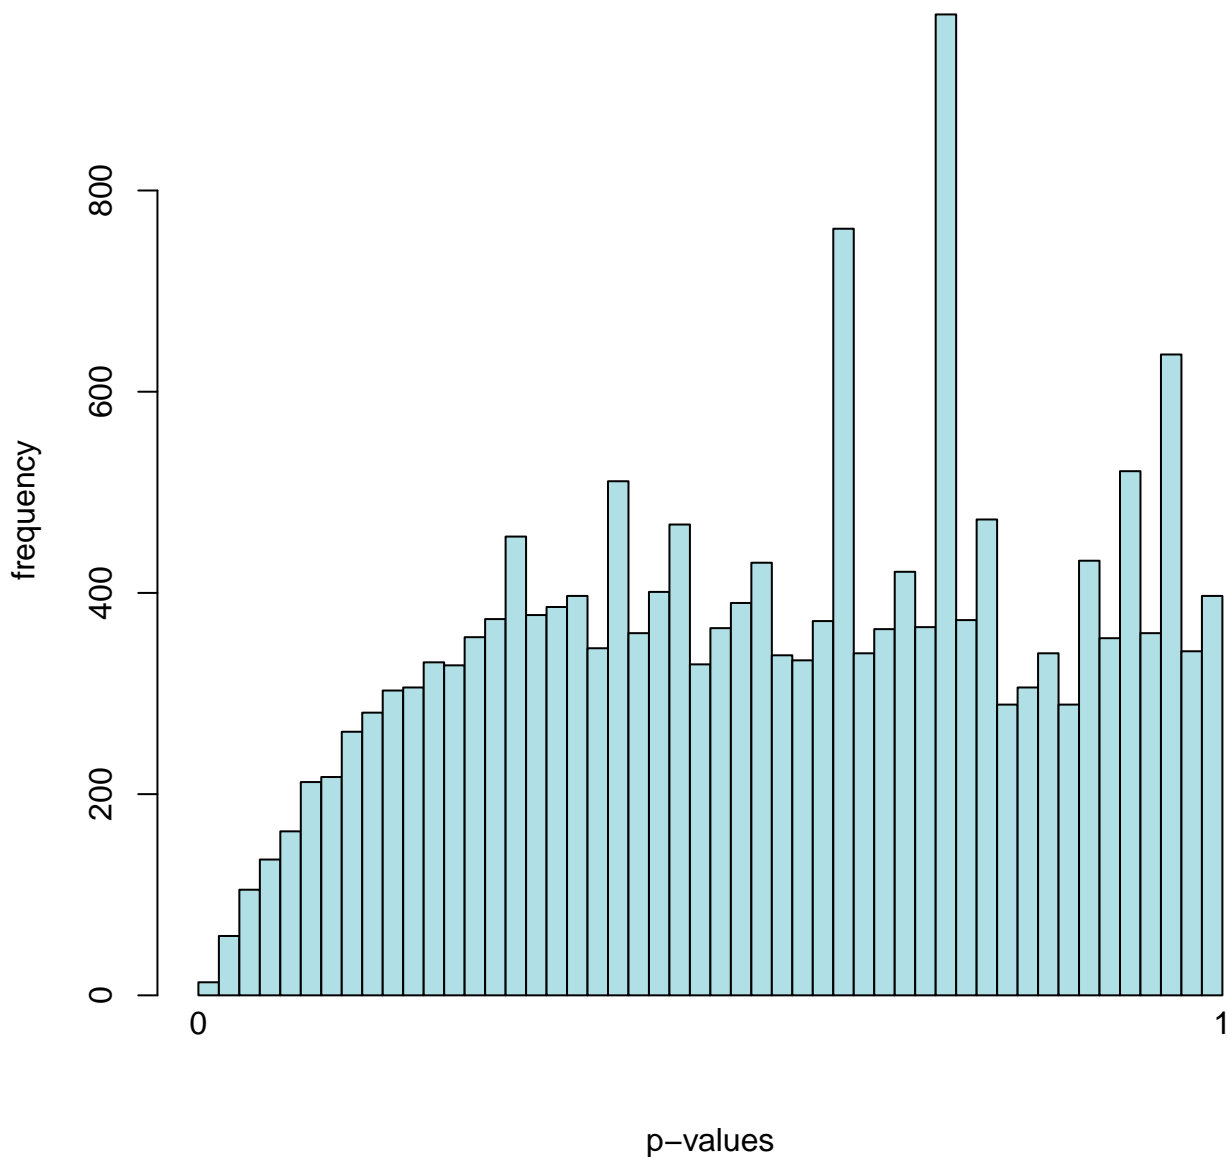

PCBXTreatedXOEID3XXvsXVectorXControlXLungXEndothelialXCellsX: tre

